

# Frost-Proof, Wall-Mounted Combination Drench Shower and Eyewash

## Model S19-310TW

- Complies with American National Standard Z358.1-2004
- Galvanized Steel Protected with BRADTECT™ Safety Yellow Coating
- Universal Identification Sign and Inspection Tag Included
- Full, One-Year Warranty

## Specifications

This unit is made specifically for areas subject to freezing. Drench shower and eyewash fits easily into any work environment where outdoor plumbed water source is not available. Shower and eyewash valves operate quickly by large, highly visible push handles. Safe, steady water flow under varying water supply conditions from 30-90 PSI is assured by integral flow control in the sprayhead assembly.

## Construction

Impact-resistant plastic shower head in bright yellow for high visibility in emergency situations. Galvanized steel piping is additionally protected against corrosion with BRADTECT™ safety yellow coating.

## Standard Equipment

### Shower Head

10" (254mm) diameter yellow impact-resistant plastic.

### Standard Sprayhead Assembly

Chrome-plated brass sprayhead assembly with twin, soft-flow, eyewash heads and protective sprayhead covers. The integral flow control assures safe, steady flow under varying water supply conditions from 30-90 PSI.

### Frost-Proof Shower and Eyewash Valves – Independent


Shower has 1" IPS stay-open valve, eyewash has 1/2" IPS stay-open valve. Hand operated by stainless steel push flag handles.

### Pipe and Fittings

Galvanized steel protected with BRADTECT™ safety yellow coating. Standard wall thickness is 8"-12". Special order for other wall thicknesses. (0"-8" or 12"-18"). Special order sizes are non-returnable

### Water Supply


1-1/4" IPS.

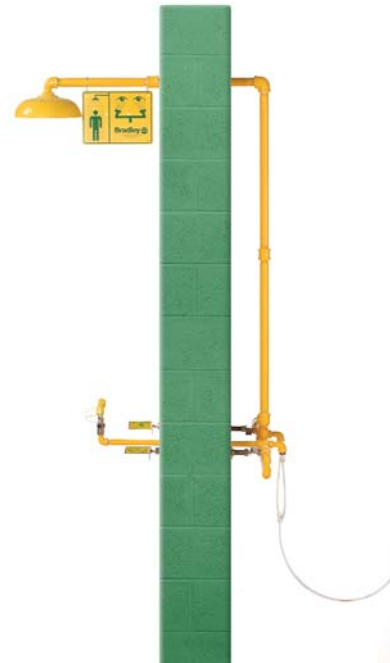

### Recommended Option:

Navigator S19-2100 EFX25  
Emergency Thermostatic Mixing Valve

**NAVIGATOR**



Satisfies ANSI Z358.1-2004  
tepid water requirements.

Document No. 4615

This information is subject to change without formal notice.  
© 2006 Bradley Corporation  
10-11-2006 (2 Pages Total)

**Bradley** 


P.O. Box 309, Menomonee Falls, WI 53052-0309  
Phone 1-800-BRADLEY FAX 262-251-5817  
Web Site: <http://www.bradleycorp.com>

EF4615.1

# Frost-Proof, Wall-Mounted Combination Drench Shower and Eyewash

## Model S19-310TW

MODEL	
Model No.	Description
<input type="checkbox"/> S19-310TW	Frost-Proof, Wall-Mounted Combination Drench Shower and Eyewash
<input type="checkbox"/> S19-2100	Navigator EFX25 – Emergency Thermostatic Mixing Valve

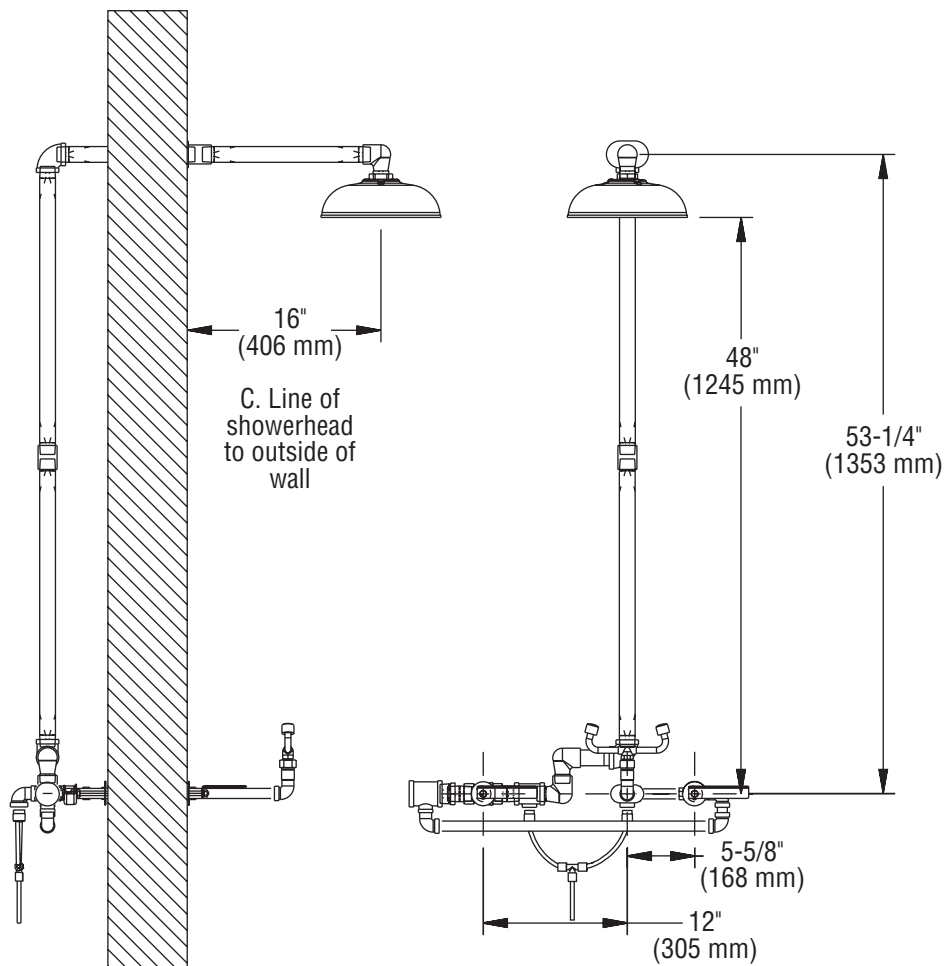

Document No. 4615

This information is subject to change without formal notice.  
© 2006 Bradley Corporation  
10-11-2006 (2 Pages Total)

**Bradley** 

P.O. Box 309, Menomonee Falls, WI 53052-0309  
Phone 1-800-BRADLEY FAX 262-251-5817  
Web Site: <http://www.bradleycorp.com>