


GEO-THERMAL WATER HEATING SYSTEM WITH HOT WATER STORAGE TANK. ONE RECIRCULATION PUMP IS USED TO CIRCULATE THE WATER BETWEEN THE STORAGE TANK AND THE GEO-THERMAL PIPING SYSTEM. ANOTHER RECIRC PUMP COULD BE USED TO CIRCULATE THE WATER BETWEEN THE STORAGE TANK AND THE BUILDING OUTLETS. INSTANTANEOUS WATER HEATERS CAN BE USED TO HELP BOOST THE WATER TEMPERATURE OR AS SUPPLEMENTAL WATER HEATING IN THE CASE THAT THE SOLAR HEATING SYSTEM CANNOT KEEP UP WITH THE DEMAND.

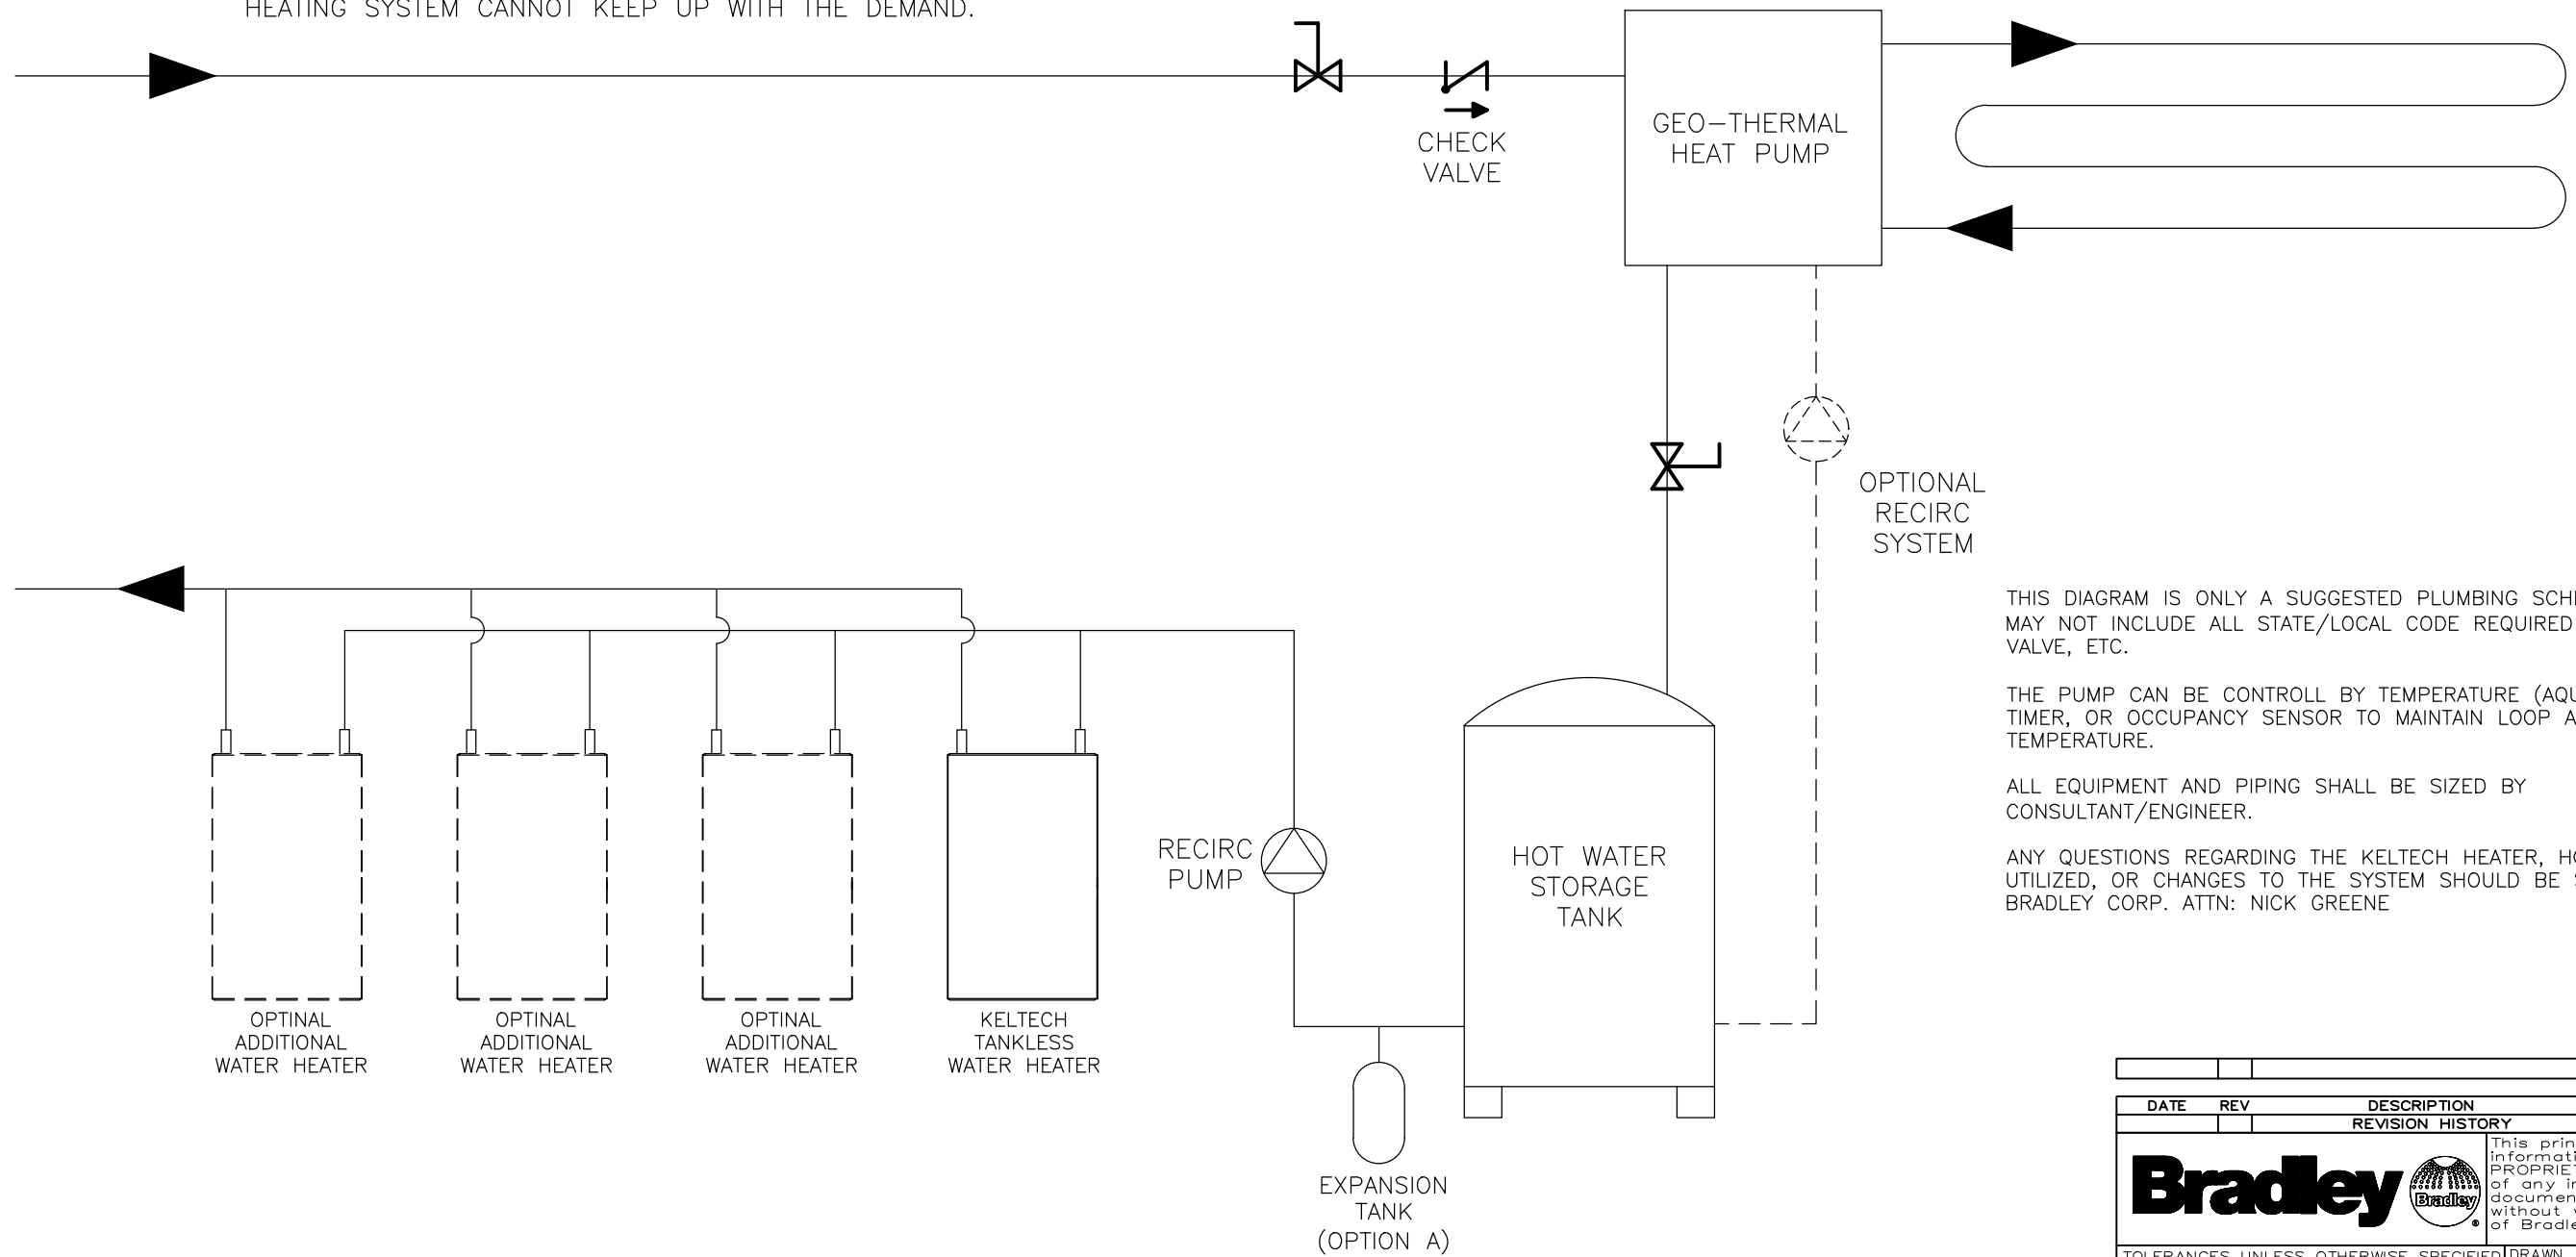


THIS DIAGRAM IS ONLY A SUGGESTED PLUMBING SCHEMATIC AND MAY NOT INCLUDE ALL STATE/LOCAL CODE REQUIRED EQUIPMENT, VALVE, ETC.

THE PUMP CAN BE CONTROLL BY TEMPERATURE (AQUASTAT), TIMER, OR OCCUPANCY SENSOR TO MAINTAIN LOOP AT USAGE TEMPERATURE.

ALL EQUIPMENT AND PIPING SHALL BE SIZED BY CONSULTANT/ENGINEER.

ANY QUESTIONS REGARDING THE KELTECH HEATER, HOW IT CAN BE UTILIZED, OR CHANGES TO THE SYSTEM SHOULD BE SENT TO BRADLEY CORP. ATTN: NICK GREENE

- GEO-THERMAL HEATING WITH BACKUP/BOOSTER HEATERS

DATE	REV	DESCRIPTION	ECN	BY
REVISION HISTORY				
<b>Bradley</b> 		This print contains information that is PROPRIETARY. Disclosure of any information on this document cannot be made without written permission of Bradley Corporation.		
		TOLERANCES UNLESS OTHERWISE SPECIFIED		
DRAWN BY:		NJG		
DATE:		10/22/14		
SCALE:		NTS		
FIRST USED:		REF:		
MATERIAL:		XXXXXXXXXX		
NAME:		XXXXXX XXXXXX		
DWG NUMBER:		XXX-XXX		SHEET 1 OF 1