


THIS DIAGRAM IS ONLY A SUGGESTED PLUMBING SCHEMATIC AND MAY NOT INCLUDE ALL STATE/LOCAL CODE REQUIRED EQUIPMENT, VALVE, ETC.

ALL EQUIPMENT AND PIPING SHALL BE SIZED BY CONSULTANT/ENGINEER.

ANY QUESTIONS REGARDING THE KELTECH HEATER, HOW IT CAN BE UTILIZED, OR CHANGES TO THE SYSTEM SHOULD BE SENT TO BRADLEY CORP. ATTN: NICK GREENE

INSTANTANEOUS WATER HEATER SYSTEM TO PREHEAT WATER PRIOR TO THE REVERSE OSMOSIS. BY PREHEATING THE WATER, THE R/O PROCESS IS MORE EFFICIENT. IF POST HEATING THE R/O OR DI SYSTEM, THE WATER HEATER WILL NEED TO BE TEFLON COATED.

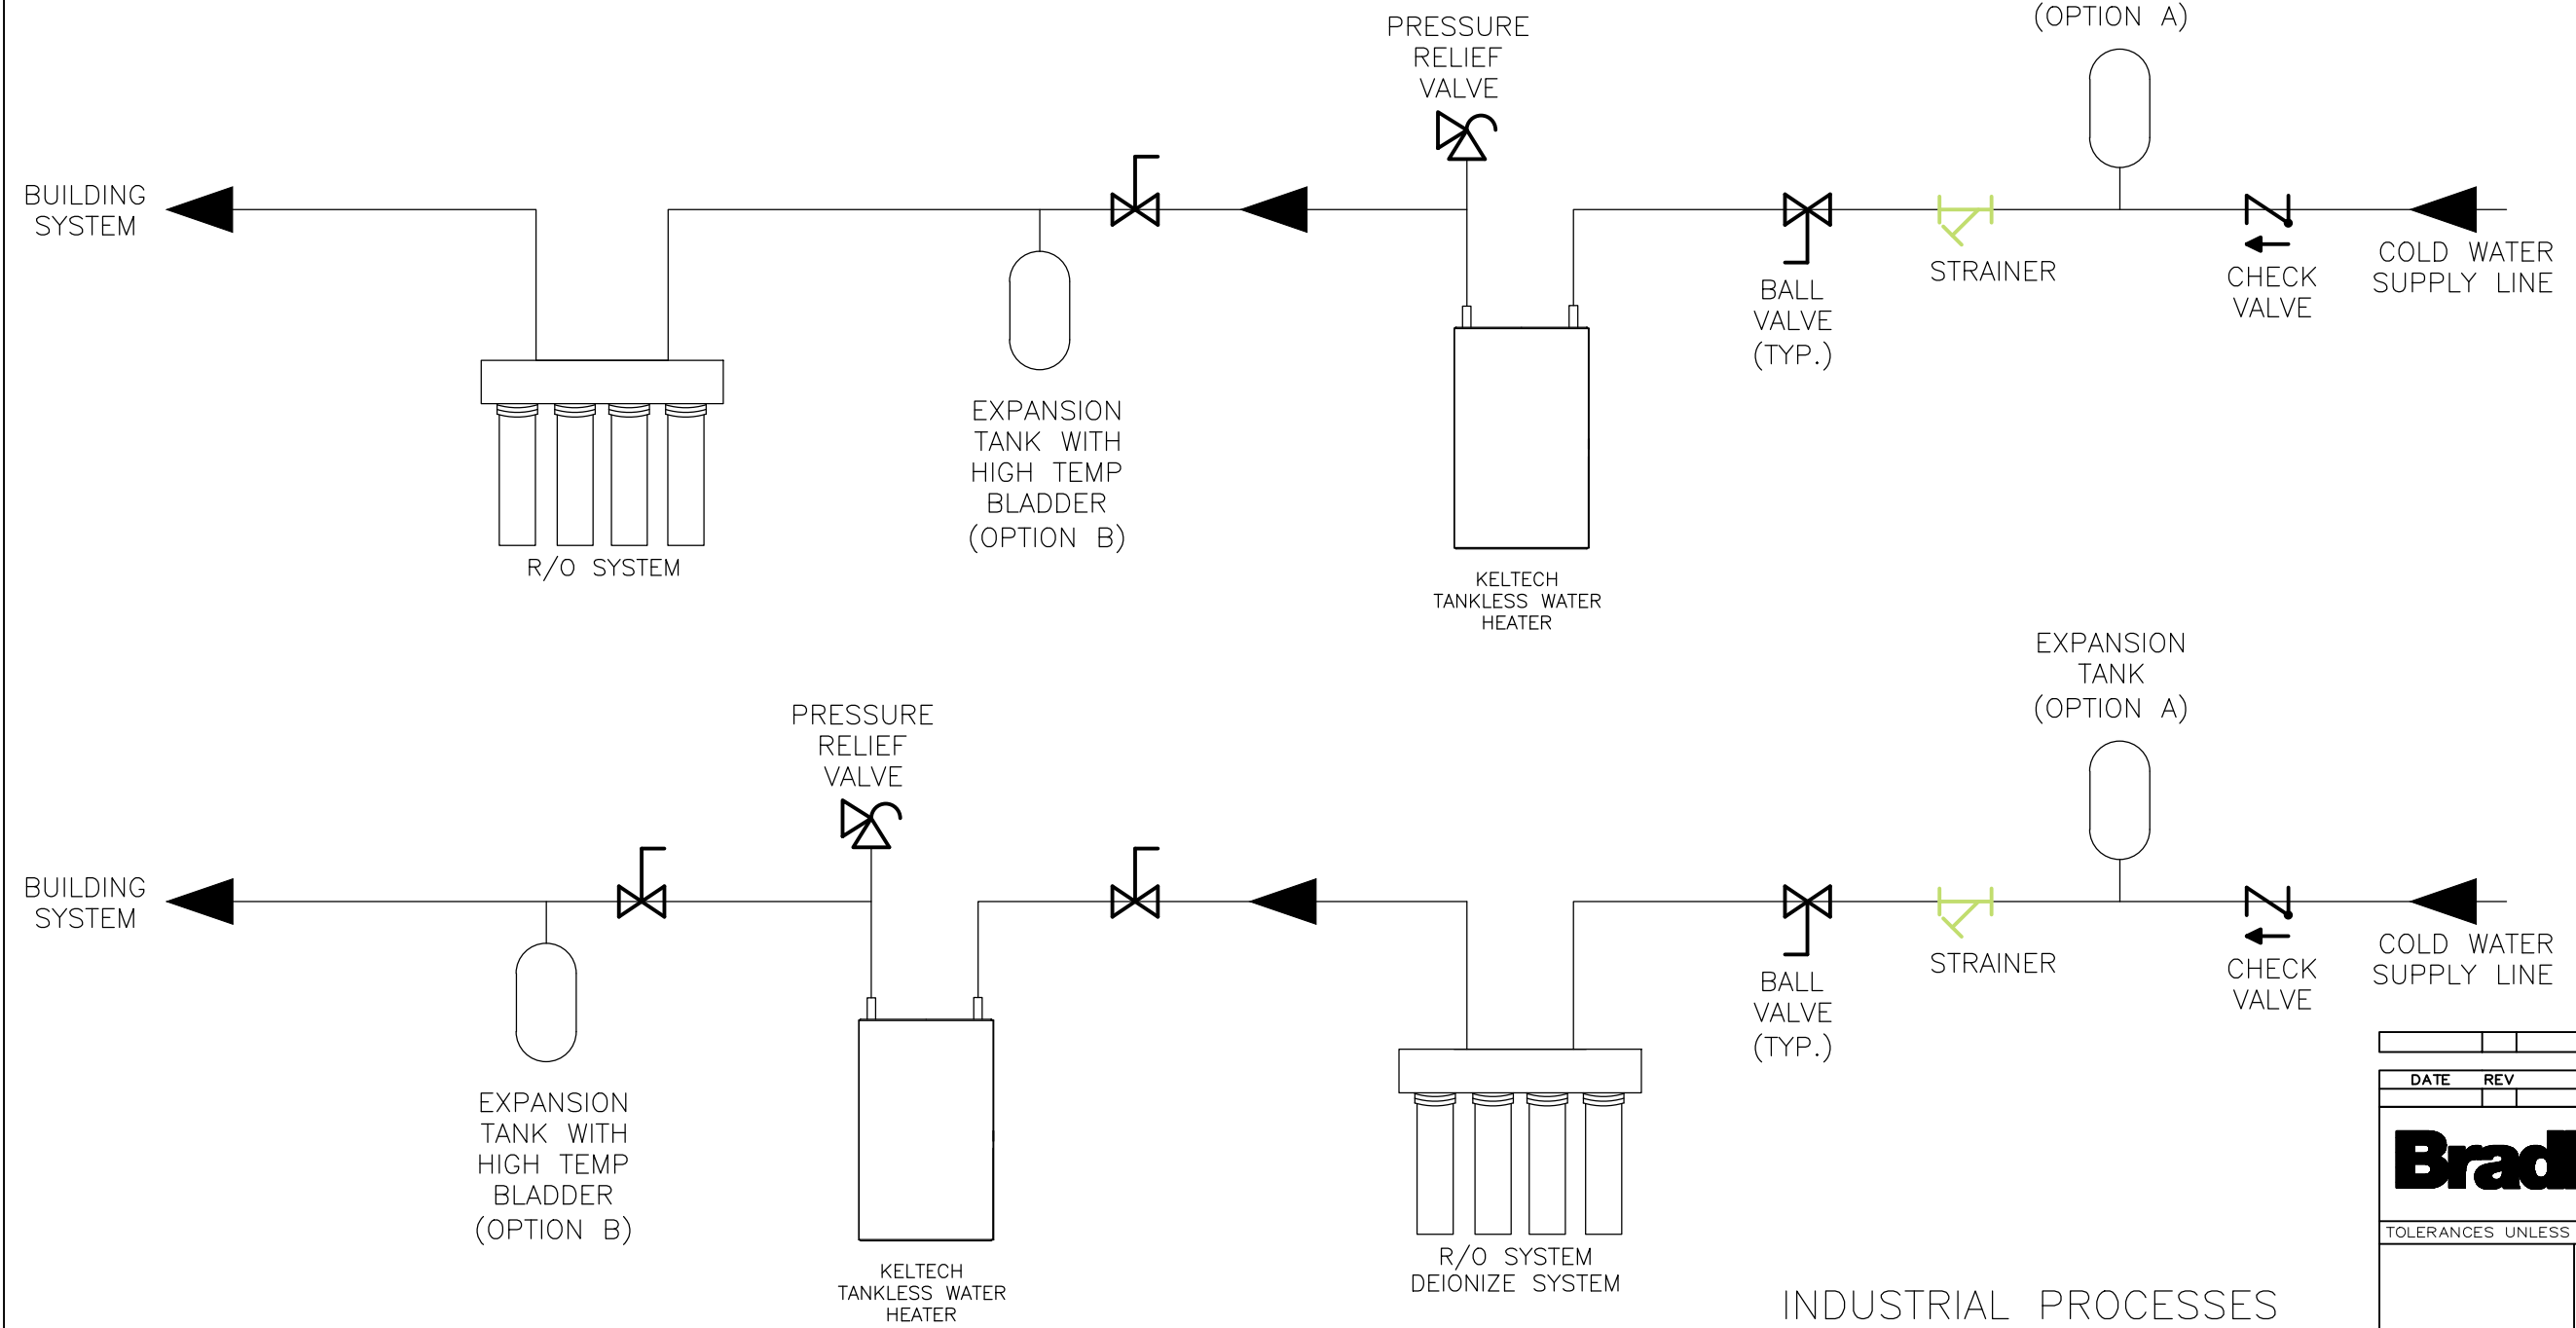

- INDUSTRIAL PROCESSES
- HEATING DEIONIZED
 - PRE-HEATING R/O WATER
 - HEATING R/O WATER W/TEFLON COATING

DATE	REV	DESCRIPTION	ECN	BY
REVISION HISTORY				
Bradley		This print contains information that is PROPRIETARY. Disclosure of any information on this document cannot be made without written permission of Bradley Corporation.		
		TOLERANCES UNLESS OTHERWISE SPECIFIED		
		DRAWN BY:	NJG	
		DATE:	10/22/14	
		SCALE:	NTS	
		FIRST USED:		
		REF:		
THIRD ANGLE		DO NOT SCALE DRAWING		
MATERIAL: XXXXXXXXXXXX				
NAME: XXXXXX XXXXXX				
DWG NUMBER: XXX-XXX				SHEET 1 OF 1